

OVERVIEW

The Model 310 from Badger Meter is a loop-powered, programmable 4...20 mA transmitter designed to accept relatively fast, unscaled raw pulses from devices like flow sensors and then transmit a linear analog signal of desired scaling and units of measure. In addition to our standard flow sensors, the Model 310 can also accept a sine wave, making it a versatile transmitter for numerous applications.

With an onboard microcontroller and digital circuitry, the Model 310 is programmed from a computer, thereby eliminating the need to adjust potentiometers and produce precise, accurate and drift-free signals. This saves both time and money by lowering overall maintenance times. This model also has an integral filter that the user can specify as values between 0 (to show true sensor readings) and 10 (for maximum dampening).

The compact cast epoxy body measures 1.75 × 2.75 × 1 in. (44 × 70 × 25 mm) and can easily be mounted to panels, DIN rails or enclosures. With field programming, input signal flexibility, ease-of-use and a variety of enclosures, the Model 310 is a powerful and competitive transmitter for many of today's demanding applications.

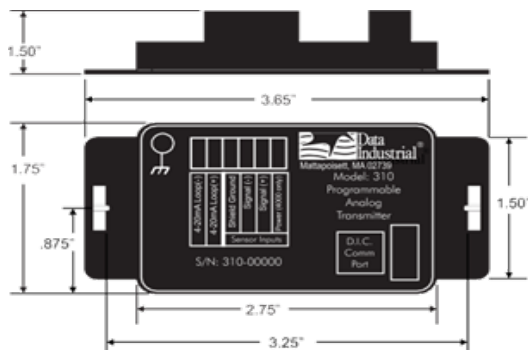


Figure 1: Dimensions

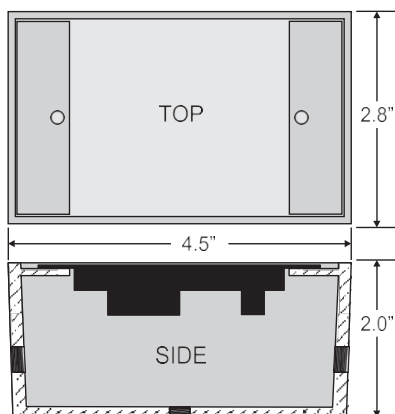


Figure 2: Optional enclosure (Ver. 310-02 and 310-03)



PART NUMBER CONSTRUCTION

EXAMPLE:		8310	-	xx
SERIES	Programmable Analog Transmitter	8310		
OPTIONS	Transmitter Only			00
	W / NEMA 4X Enclosure			01
	W / Metal Weatherite Enclosure			02
	W / Plastic Weatherite Enclosure			03
	W / DIN rail Mounting Clips			04

Figure 3: Model 310 ordering matrix

SPECIFICATIONS

Power Requirements	Loop input voltage 9...35V DC
Input Frequency	0.4...10 kHz
Load Resistance	Max 750 Ω at 24V DC
Output Response Time	Varies with filter
Temperature (Operating)	-20...158° F (-29...70° C)
Temperature (Storage)	-40...185° F (-40...85° C)
Accuracy	±0.04% of reading over entire span
Linearity	0.1% of full scale

CALIBRATION

Units can be calibrated at our facility or easily programmed in the field. Field calibration requires an 840134-0002 programming kit (consisting of a custom cable and software) and a computer (PC) running a Windows® operating system. To calibrate, the Model 310 must be connected to the loop for power and the 840134-0002 programming kit cable must be connected to the computer.

Once the software is loaded and transmitter communication is established, the following parameters are entered on the setup screens:

- Units of measure
- K and Offset values – selected from the sensor owners manual or for insert style sensors entering the pipe ID allows the software to calculate the K and Offset values
- Flow rate represented by 4 mA
- Flow rate represented by 20 mA

An added feature is a user selectable filter. Set at the minimum (0), the transmitter reacts to actual flow input. Set at the maximum (10), the transmitter provides the greatest dampening possible. Once the values are set, the "send" command loads the transmitter.

WIRING

Per standard wiring practices, the loop power must be off before making any wire connections. The terminal strips have removable plug-in connectors to make wiring easier. Refer to [Figure 4](#) for terminal connections.

1. Connect loop power supply positive (+) to the terminal marked 4...20 mA loop (+).
2. Connect the terminal marked 4...20 mA loop (-) of the Model 310 to the positive analog terminal of the input device (like Chart Recorder or PLC).

3. Connect negative analog terminal of the input device to loop power supply negative.
4. If wiring a 200 sensor, connect the red wire (signal) to the Signal (+) terminal, black wire (ground) to the Signal (-) terminal, and the shield to the Shield Ground terminal (disregard shield for the IR sensors).

If wiring a 4000 sensor, connect the clear wire (signal) to the Signal (+) terminal, black wire (ground) to the Signal (-) terminal, shield wire to the Shield Ground terminal, and red wire (power) to the Power (4000 only) terminal. If the sensor is not a Badger Meter Data Industrial 200, go to step 6.

5. For maximum EMI protection, connect the Model 310 ground lug to the panel ground.
6. Make sure all connections are tight. Then plug the connector into the header.


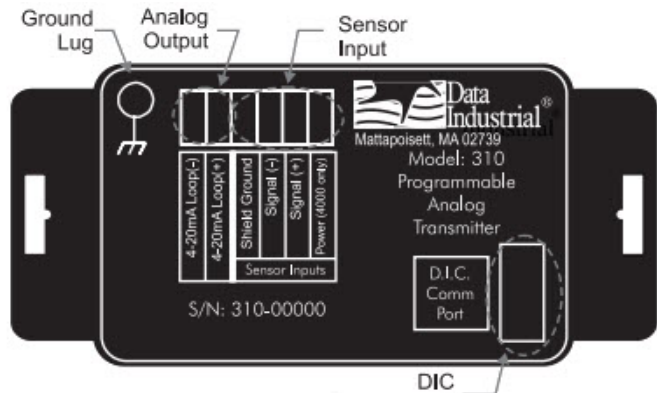


Figure 4: Terminal connections

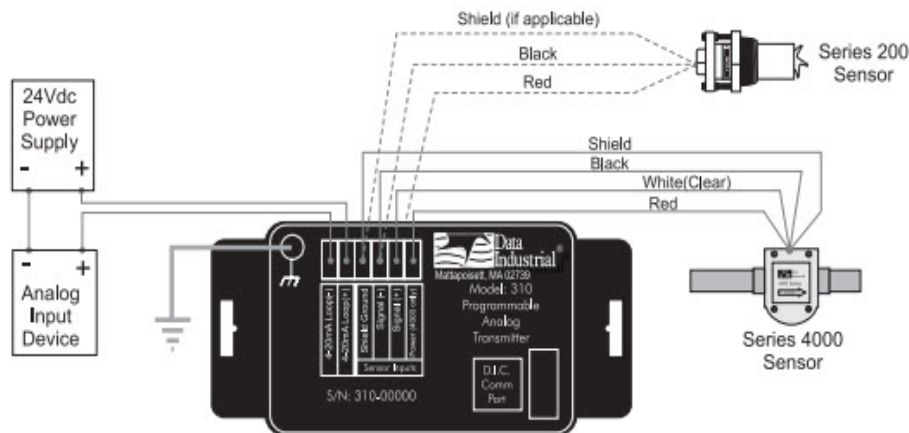

Control. Manage. Optimize.

Data Industrial is a registered trademark of Badger Meter, Inc. Other trademarks appearing in this document are the property of their respective entities. Due to continuous research, product improvements and enhancements, Badger Meter reserves the right to change product or system specifications without notice, except to the extent an outstanding contractual obligation exists. © 2023 Badger Meter, Inc. All rights reserved.

www.badgermeter.com